


The Isle of Man Electrical Interconnector

This chart is provided to indicate the route positions of the UK-Isle of Man Electrical Interconnector cable. It is given for assistance and guidance.
The Manx Cable Company accept no liability for any inaccuracies however caused.

Water depth are taken from Admiralty Charts and are shown relative to Chart Datum

Snagging Event - Emergency Contact
Cable Name - Isle of Man Interconnector Power Cable
Contact - BT Marine Liaison Officer
Telephone Number (24 hrs)
023 80 82 98 06

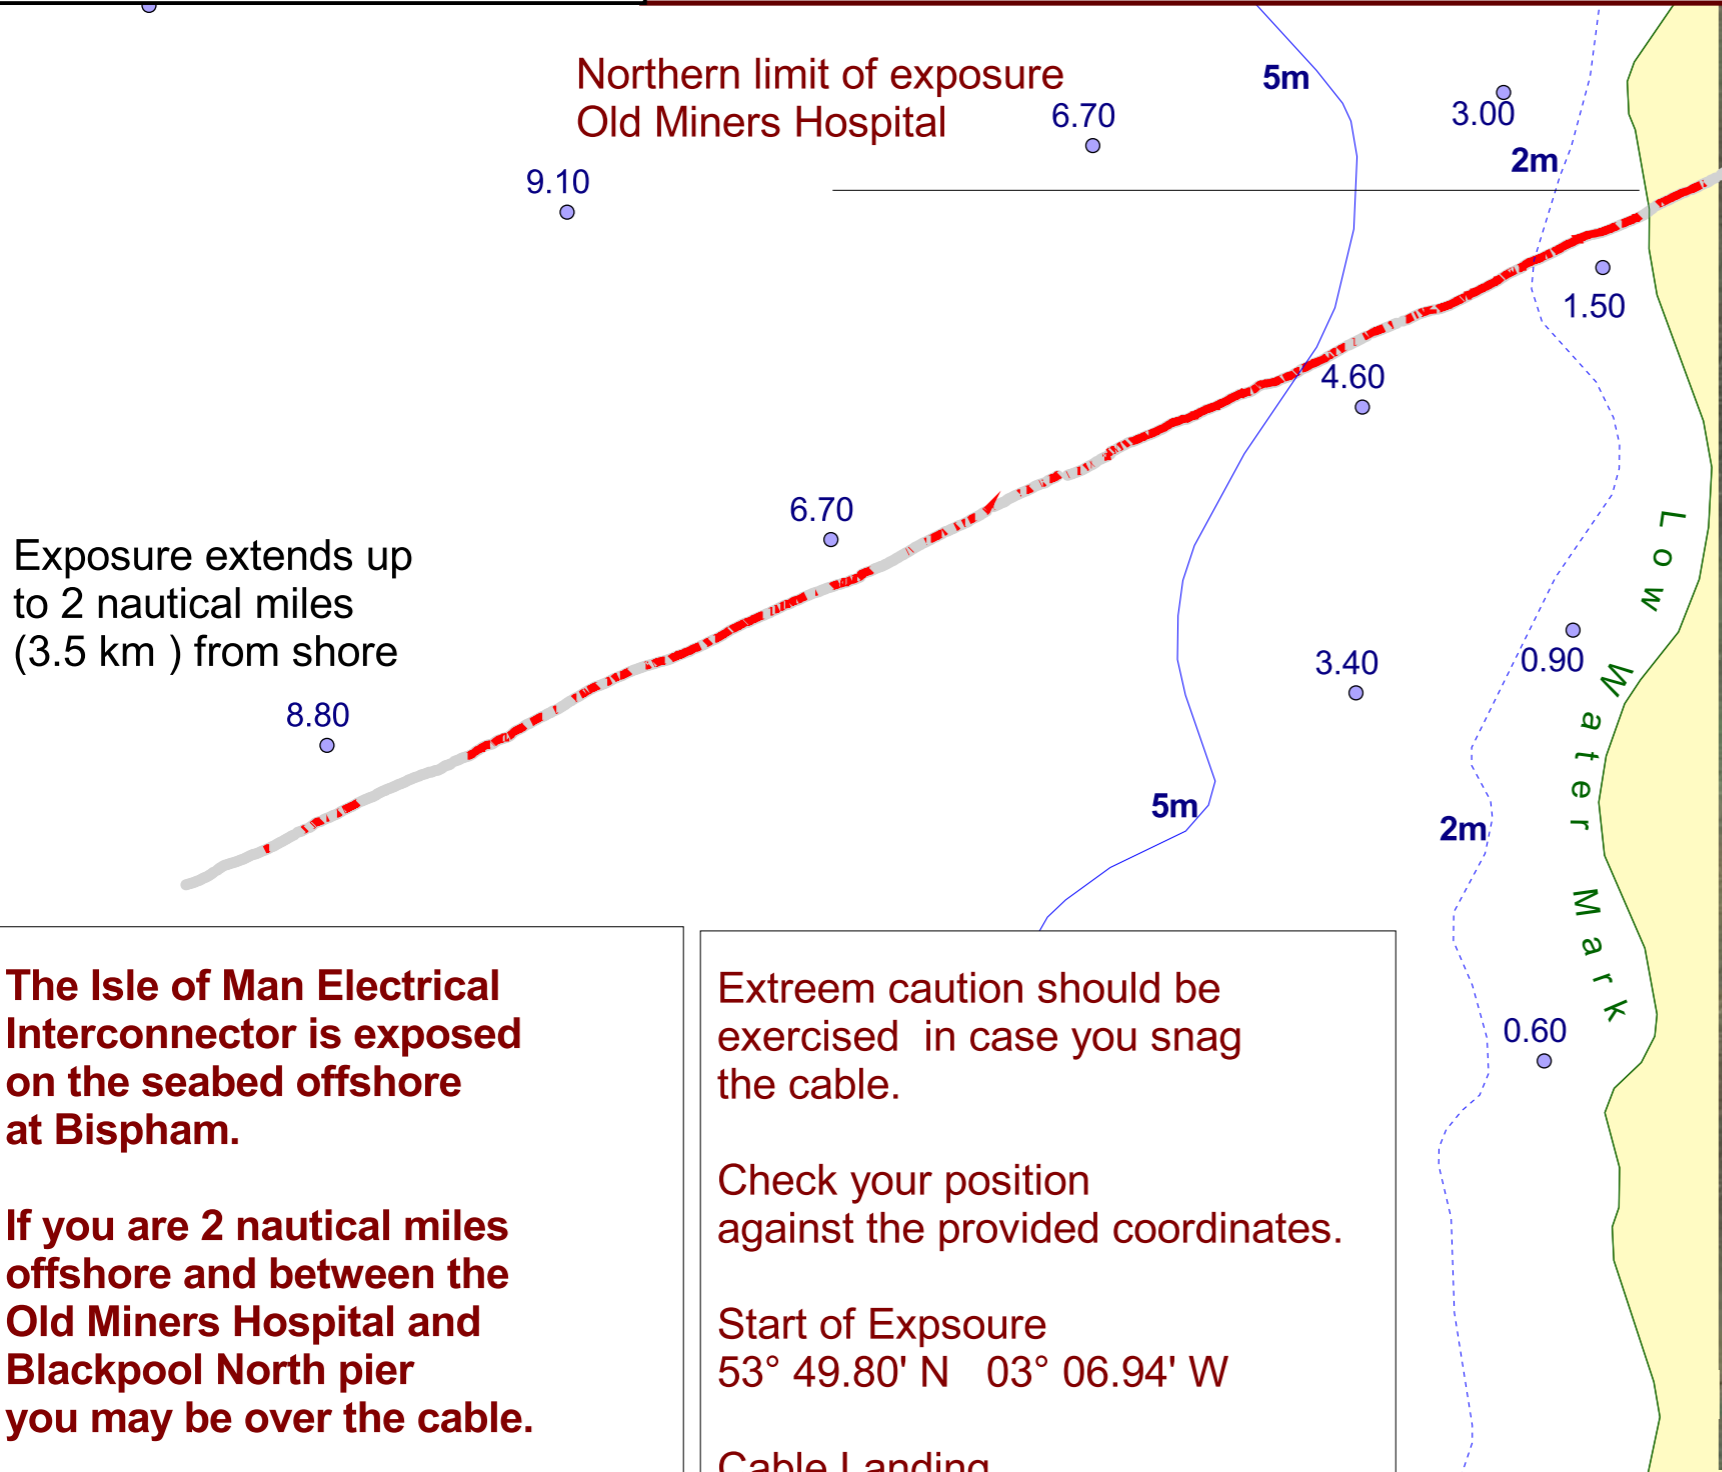

Exposure extends up to 2 nautical miles (3.5 km) from shore



Change in colour of seawall close to shore end cable marker



Southern limit of exposure Blackpool North Pier

The Isle of Man Electrical Interconnector is exposed on the seabed offshore at Bispham.

If you are 2 nautical miles offshore and between the Old Miners Hospital and Blackpool North pier you may be over the cable.

Exposed cable shown in red along route.

Extrem caution should be exercised in case you snag the cable.

Check your position against the provided coordinates.

Start of Exposure
 53° 49.80' N 03° 06.94' W

Cable Landing
 53° 50.84' N 03° 03.29' W

This product has been derived, in part, from Admiralty charts and publications with the permission of the UK Hydrographic Office and the Controller of Her Majesty's Stationery Office under Licence No. HO 552/020121/05. All rights reserved. (Not to be used for Navigation).