

# The Isle of Man Electrical Interconnector

This chart is provided to indicate the route positions of the UK-Isle of Man Electrical Interconnector cable. It is given for assistance and guidance. The Manx Cable Company accept no liability for any inaccuracies however caused.


Water depth are taken from Admiralty Charts and are shown relative to Chart Datum

## Snagging Event - Emergency Contact

**Cable Name - Isle of Man Interconnector Power Cable**

**Contact - Manx Utilities Interconnector Manager: 07624 498792**

**Telephone Number (24 hrs): 01624 687 687**

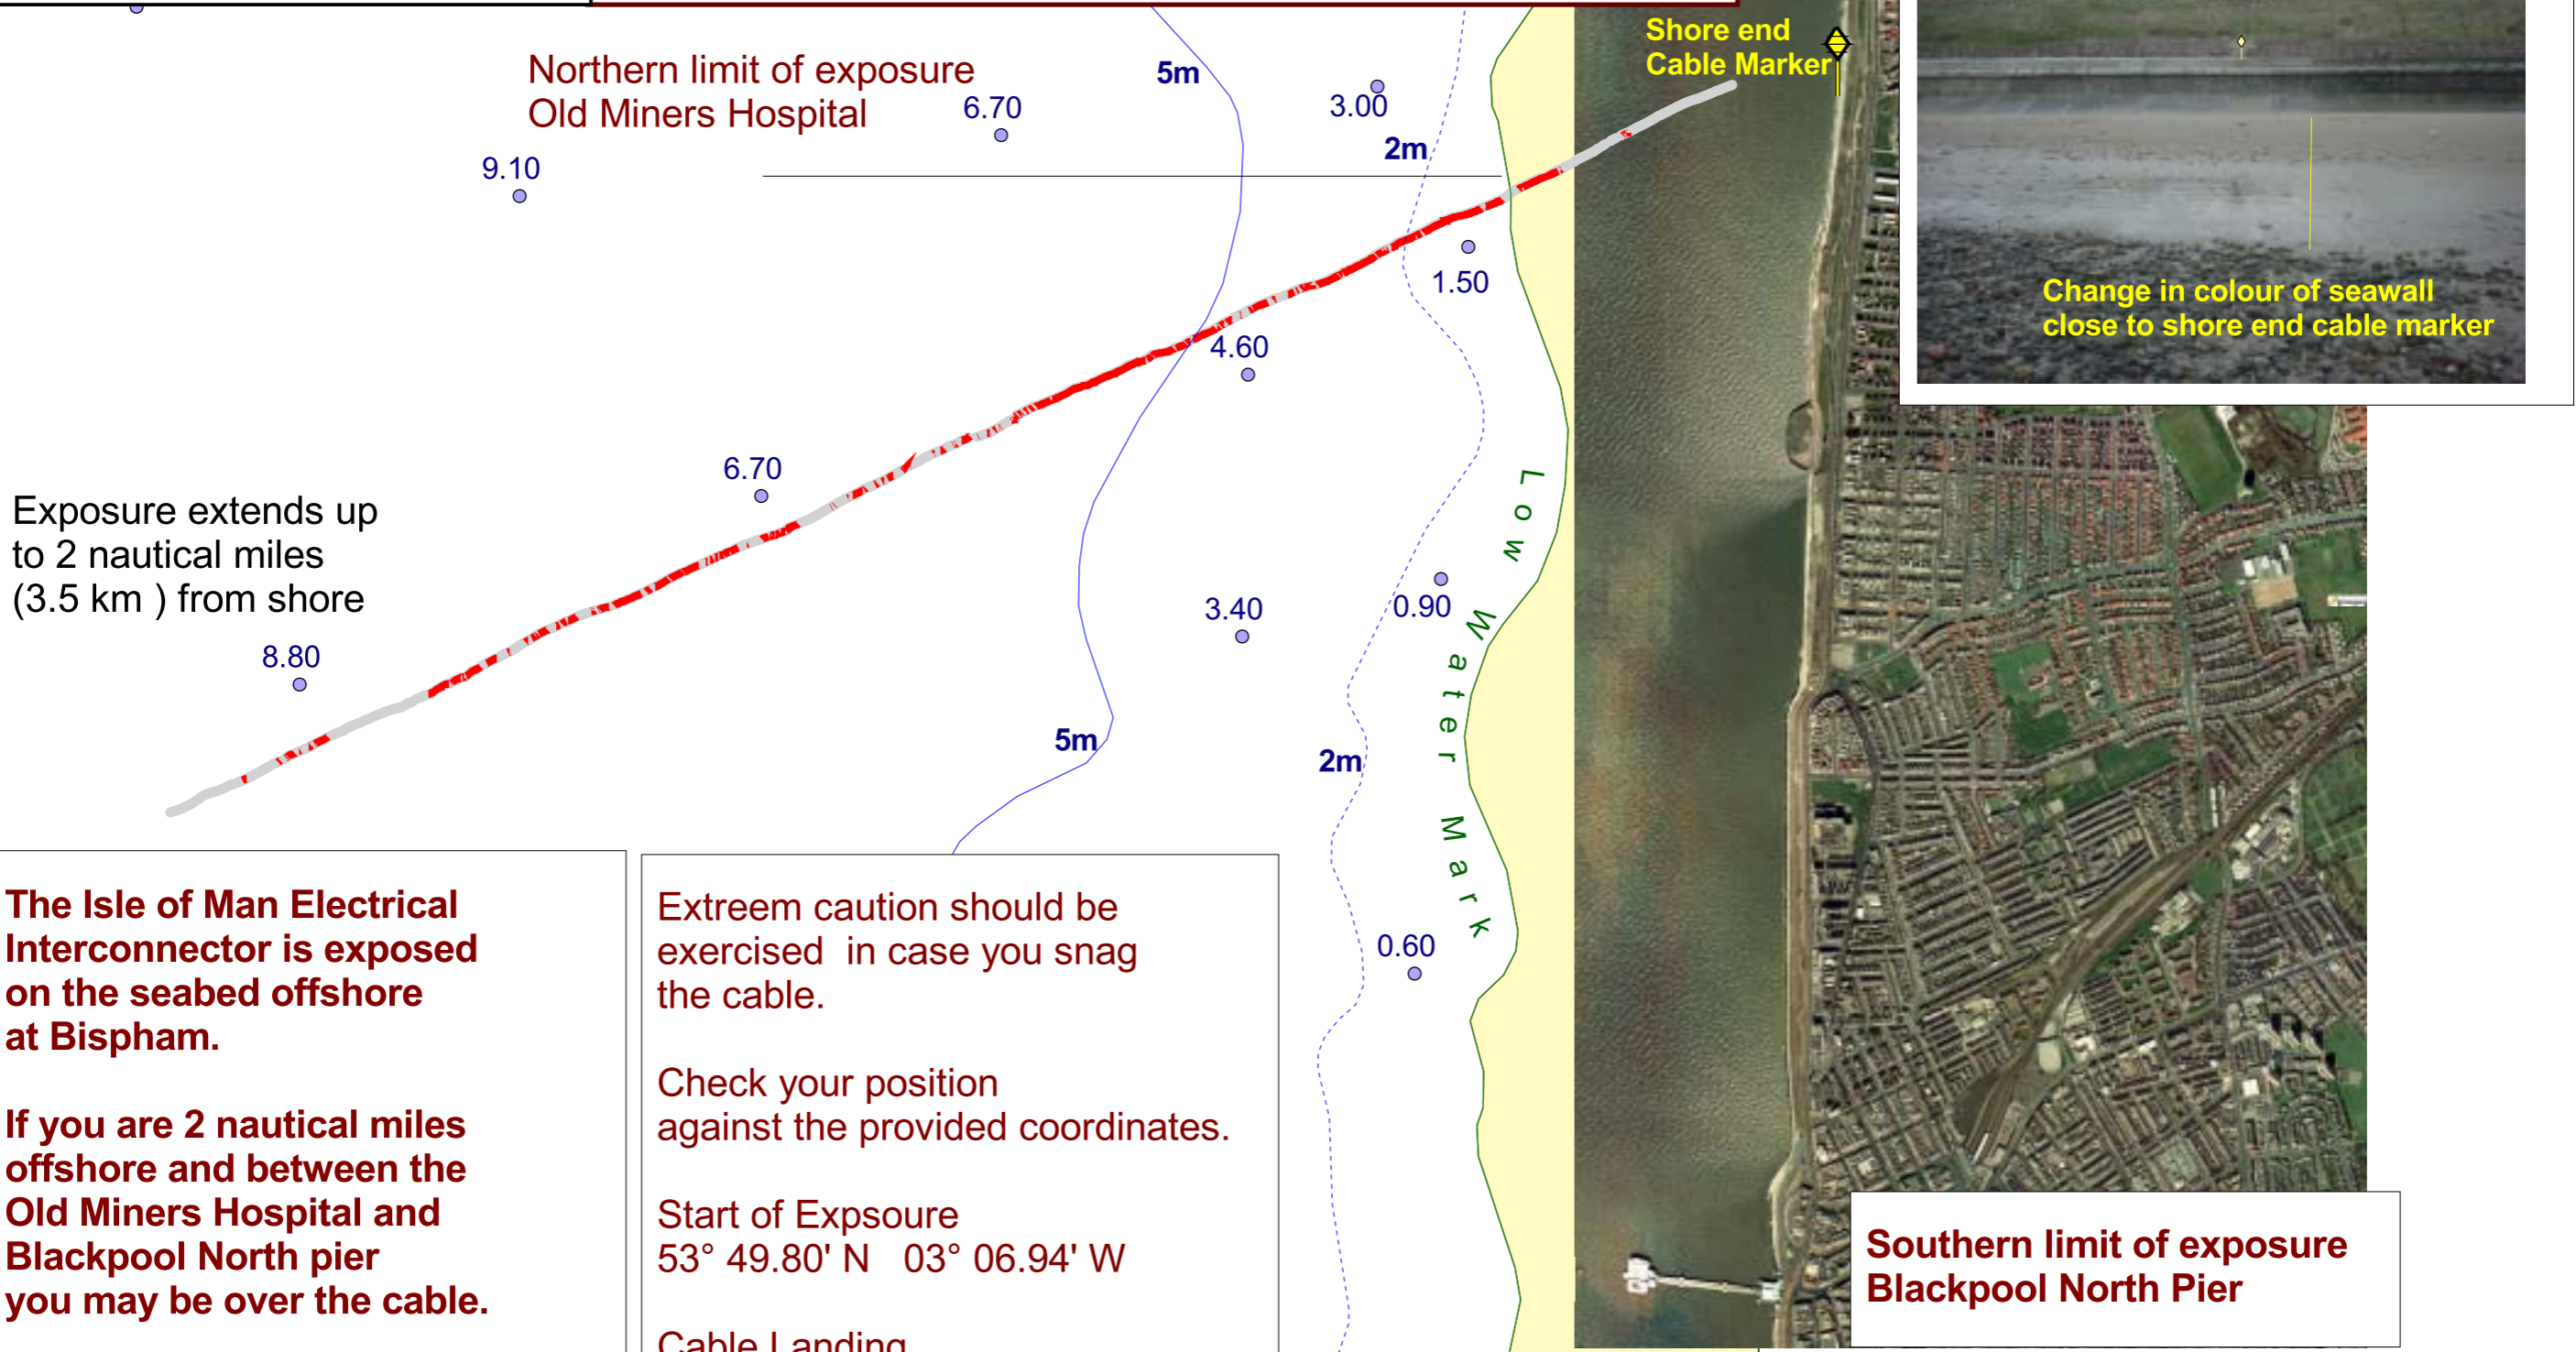

**The Isle of Man Electrical Interconnector is exposed on the seabed offshore at Bispham.**

**If you are 2 nautical miles offshore and between the Old Miners Hospital and Blackpool North pier you may be over the cable.**

**Exposed cable shown in red along route.**

Extrem caution should be exercised in case you snag the cable.

Check your position against the provided coordinates.

Start of Exposure  
53° 49.80' N 03° 06.94' W

Cable Landing  
53° 50.84' N 03° 03.29' W

This product has been derived, in part, from Admiralty charts and publications with the permission of the UK Hydrographic Office and the Controller of Her Majesty's Stationery Office under Licence No. HO 552/020121/05. All rights reserved. (Not to be used for Navigation).